

MINUTE ITEM

This Calendar Item No. C10  
was added to the Item  
No. 10 2  
to 0 4/26/79  
meeting.

CALENDAR ITEM

C10.

AMENDMENT OF PRIOR AUTHORIZATION

4/79  
WP 3875  
Gordon  
PRC 3875

APPLICANT: South San Luis Obispo County  
Sanitation District  
P. O. Box 550  
Arroyo Grande, California 93420

At its meeting on January 25, 1979, as Minute Item C4 and by reference made a part hereof, the Commission authorized issuance to South San Luis Obispo County Sanitation District of a 49-year General Lease - Right-of-Way Use from March 1, 1979; in consideration of the public health and safety, with the State reserving the right to set a monetary rental if the Commission finds such action to be in the State's best interest; provision of public liability insurance in the amount of \$500,000 per occurrence for bodily injury and \$500,000 for property damage, or combined single limit coverage of \$1,000,000; for construction, reconstruction, placement and maintenance of 1 existing 36-inch outfall pipeline and 1 new 24-inch outfall pipeline capped with twin diffusers, together with a contiguous 2-year temporary construction easement, for the discharge of wastewater and effluent into the Pacific Ocean.

Subsequent to the Commission's action and prior to issuance of said lease, an amendment of applicant's project plans and specifications has increased the sizing of the subject new 24-inch outfall pipeline to a 30-inch facility, to more adequately handle the peak flow. This modification is supported by the staffs of the Regional Water Quality Control Board and the Regional Coastal Commission and does not represent an increase in the disposal system's overall ocean outfall capacity. All other terms and conditions of said lease remain unchanged.

EXHIBIT: A. Location Map.

IT IS RECOMMENDED THAT THE COMMISSION:


1. DETERMINE THAT APPROPRIATE CEQA FINDINGS WERE MADE ON THIS PROJECT BY THE COMMISSION AT ITS JANUARY 25, 1979 MEETING (MINUTE ITEM C4) AND THAT ADDITIONAL ENVIRONMENTAL ANALYSIS OF THESE ACTIVITIES ARE NOT REQUIRED.

CALENDAR PAGE 030  
MINUTE PAGE 675

CALENDAR ITEM NO. C10.(CONTD)

2. APPROVE THE INCREASING OF THE SIZE OF THE NEW 24-INCH OUTFALL PIPELINE TO A 30-INCH FACILITY AS APPROVED BY THE REGIONAL WATER QUALITY CONTROL BOARD AND THE REGIONAL COASTAL COMMISSION; ALL OTHER TERMS OF SAID LEASE PRC 3875.9 TO REMAIN IN FULL FORCE AND EFFECT.

CALENDAR PAGE	031
MINUTE PAGE	676

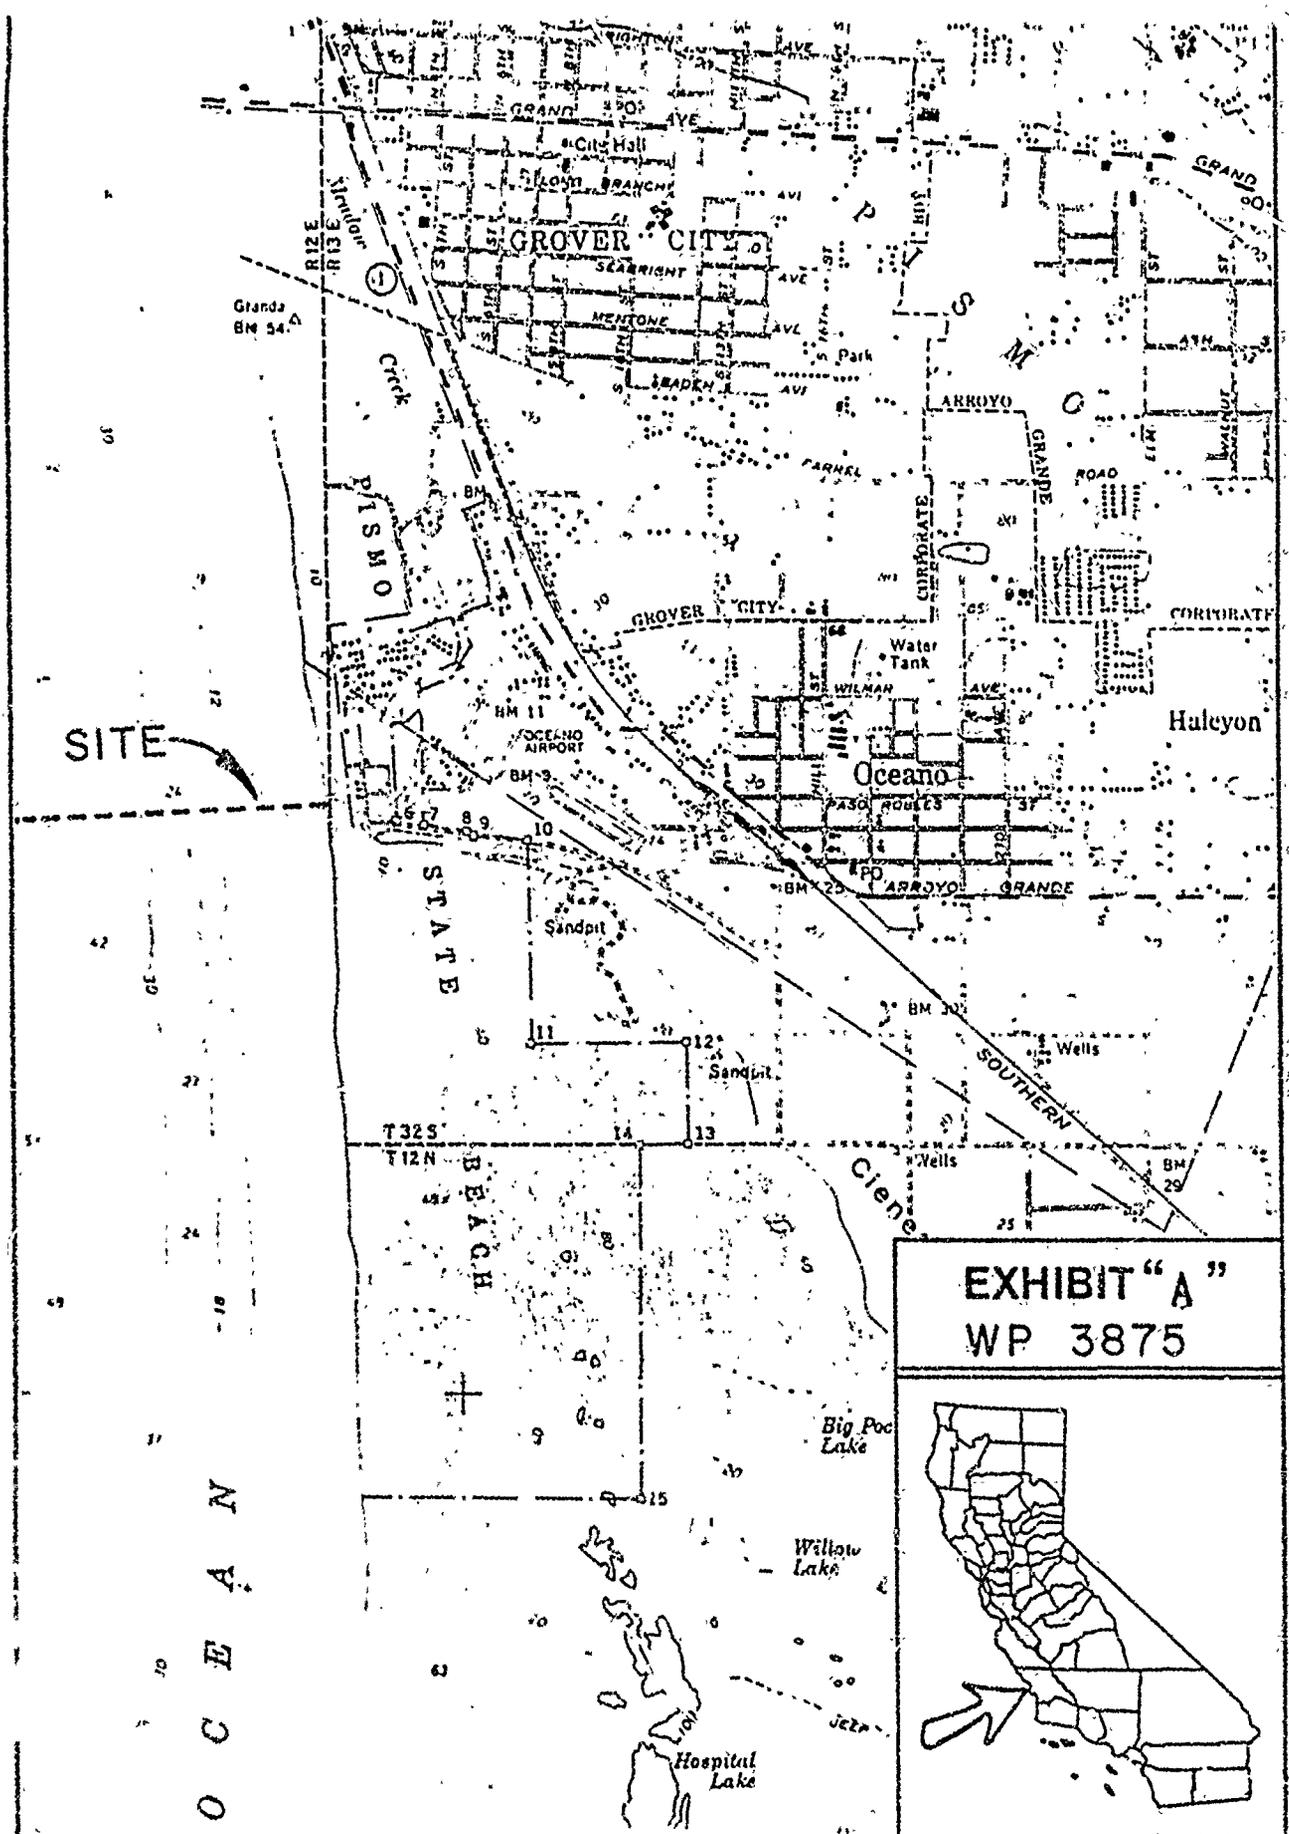

SITE

EXHIBIT "A"  
WP 3875



CALENDAR PAGE 032  
MINUTE PACE 677